



WEST VALLEY REGIONAL FIRE TRAINING CONSORTIUM



ENGINE COMPANY

STANDARD TRAINING EVOLUTION

EVOLUTION DESCRIPTION

101

1 3/4" PRECONNECT FOR FIRE ATTACK

EQUIPMENT PERFORMANCE STANDARD

(1) Engine Co.
Water Supply
Simulated Target
Stopwatch

3 FF COMPANY

4 FF COMPANY

0:00


0:00

PROCEDURE

- TIME STARTS**
- ENGINE STOPS AT HYDRANT
 - FORWARD LEAD (DRY) 200' OF LDH FOR SUPPLY
 - ENGINE STOPS AT SCENE
 - DEPLOY 1 3/4" PRECONNECT HOSELINE FOR FIRE ATTACK TO TARGET AREA
 - 1 3/4" HOSELINE CHARGED, ATTACK CREW DON SCBA
 - ESTABLISH STREAM, ADVANCE 50' WHILE FLOWING

- TIME STOPS** HOSE LINE IN OPERATION & OBJECTIVES COMPLETE:
- HOSE ADVANCED TO TARGET, ADEQUATE FLOW ESTABLISHED (150 GPM)
 - SUPPLY HOSE CONNECTED TO INTAKE, PREPARED TO RECEIVE SUPPLY
 - RELIEF VALVE SET ACCORDING TO DEPARTMENT SOG

DIAGRAM

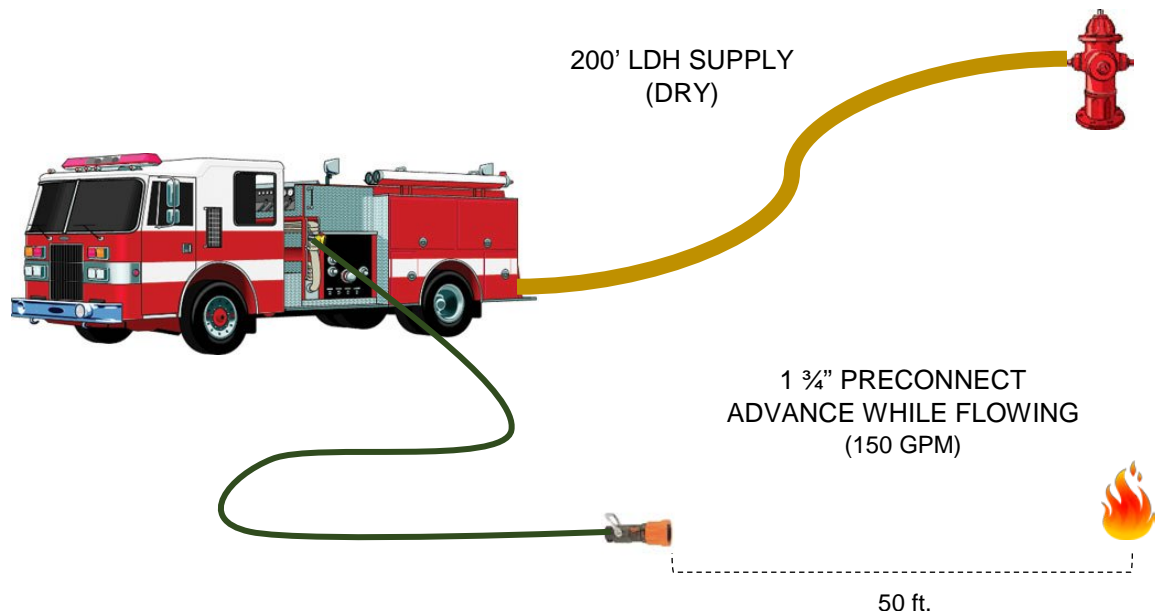

REFERENCE

NFPA 1410 : STANDARD ON TRAINING FOR INITIAL EMERGENCY SCENE OPERATIONS
DEPARTMENT / REGIONAL SOGs

A.6.1.1(a)
#